

Fire extinguishing device for container fire

Water Mist Lance

- Ministry of Land, Infrastructure and Transport

Approved Number: 5565

* In the case of container fire, make a hole in the container with a hammer
then inserts a nozzle a nozzle and sends water from the fire hydrant
into the container.

RINA No. FPE 251415 ws/001 * Water Mist Lance


Material : Mist Nozzle – SUS316

Impact Hammer – 45# (plating nickel on surface)

Size : Hammer- 478±5mm

Mist Lance - 520±5mm

Weight : 5.5kgs±0.5kg

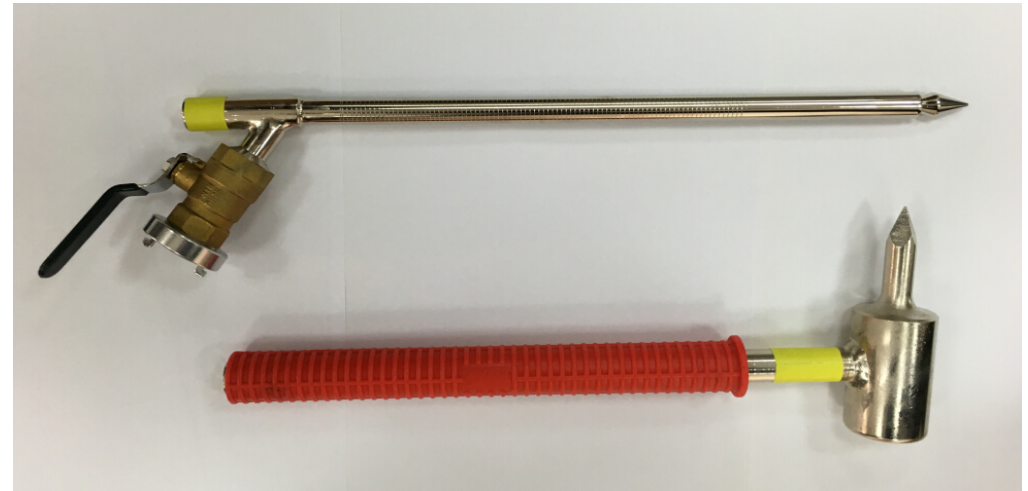

Mobile Water Monitor

- Ministry of Land, Infrastructure and Transport

Approved Number: 5566

* If a container fire more than 5 levels high on the deck, the mobile water monitor sprays water on
the top container.

MED 045917 WS * Mobile Water Monitor

Material : SUS316, Hpb59-1

Size : 900 x 650 x 420mm

Weight : 22kgs

SOLAS Convention II-2 Chapter 10 Rules

Installation is required by IMO resolution MSC.365 (93).

Target ship: lay the keel after January 1, 2016



Distributor : Kand K Co.,Ltd.

2-13-9 Higashi-Nihonbashi, Chuo-ku, Tokyo Japan

T E L 03-5822-0341/ F A X 03-5687-0234